




JW Draperies Healthcare Services
Specification Section 102123 Cubicle Curtains and Track

JW-98 Cubicle Curtain Track - Section Size: 1-3/8" x 3/4" x .058" extruded 6063-T5 satin anodized aluminum. Use JW-100 carriers or JW-600 spool carriers

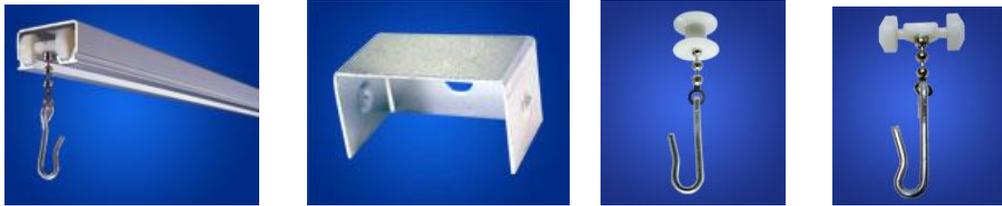

CURTAIN TRACKS

A. Manufacturer: Cubicle curtain track shall be Model JW-98, as manufactured by JW Draperies, Inc., or Architect approved equal.

B. Extruded Aluminum Track: Cubicle track shall be extruded 6063-T5 aluminum, 1 3/8" by 3/4" by .058" wall thickness, one piece, and surface mounted.

1. Curved track: Factory-fabricated, 12" radius bends.
2. Finishes: Satin anodized or electrostatic white paint finish.

C. Track Accessories: Fabricate splices, end caps, and snap outs from same material and with same finish as track.

1. End Stop: Removable with carrier hook.

D. Curtain Carriers: JW-100 wheeled nylon roller carrier or JW-600 Spool carrier with steel bead chain and hard aluminum hook, 2.2 per foot.

CURTAINS

A. Manufacturer: Subject to compliance with requirements, provide products by the following:

1. Fabric Manufacturer:
2. Pattern Name:
3. Color:

B. Curtain Grommets: Two-piece, rolled-edge, rustproof aluminum; spaced not more than 6 inches on center; machined into top hem.

C. Mesh Top: No. 50, 20" Wide, 1/2" Hole flame resistant nylon mesh.

D. Optional Curtain Tieback: Flame resistant, woven polyester strap with self-adhesive aluminum wall plate.



CURTAIN FABRICATION

A. Fabricate curtains to comply with the following requirements:

1. Width equal to track length from which curtain is hung plus 10 percent added fullness, but not less than 12 inches added fullness.
 2. Length equal to floor-to-ceiling height minus 20 inches from finished ceiling at top, and minus distance above the finished floor at bottom as follows:
 - a. Cubicle Curtains: 12 inches
 - b. Shower Curtains: 1 inches
 3. Top Hem: To be 1-1/2" wide, triple thickness, and double locked stitched.
 4. Mesh Top: To be No. 50, 20" Tall, 1/2" Hole double lock stitched to top of curtain fabric, with a 1/2" wide triple thick top seam. Mesh to have a 1-1/4 inch 100% flame resistant polyester tape double lock stitched into top hem for secure machining of grommets.
 5. Bottom Hem: To be 1-1/2" wide double thickness double lock stitched.
 6. Side Hem: To be 1/2" wide turned and single lock stitched.
- B. Vertical Seams: Not less than 1/2" wide, double turned and double stitched.

EXECUTION

EXAMINATION

A. Examine substrates and conditions, with installer present, for compliance with requirements for installation tolerance, and other conditions affecting performance of work.

1. Proceed with installation only after unsatisfactory conditions have been corrected.

INSTALLATION

A. General: Install tracks level and plumb, according to manufacturer's written instructions.

1. Curtain Track Mounting: Surface.

B. Track Accessories: Install splices, end caps, connectors, end stops, snap outs, and other accessories as required for a secure and operational installation.

C. Curtain Carrier: Provide curtain carrier adequate for 6 inch spacing along full length of curtain.

D. Curtains: Hang curtains on each curtain track. Secure with optional curtain tieback.